


MORENO VALLEY STANDARD No MVEU-727B-0

**CONDUIT SPACERS METHOD B**

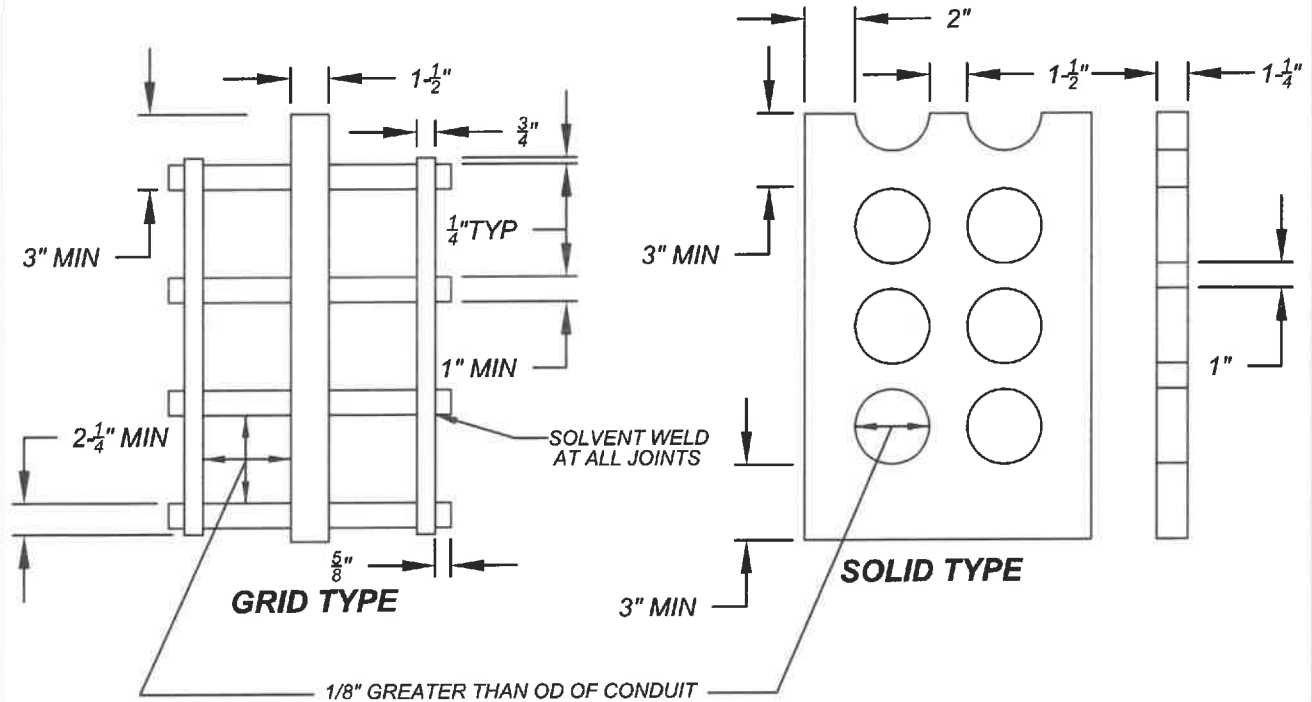

**NOTES:**

- 1.) MATERIAL:
  - A. GRID-TYPE SPACER TO BE FABRICATED TO PLASTIC CONDUIT WITH MINIMUM WALL THICKNESS OF 0.09 INCHES.
  - B. SOLID-TYPE SPACER TO BE FORMED OF POLYURETHANE WITH A MINIMUM DENSITY OF 4lb/cf.
- 2.) TIERS MAY BE ADDED OR DELETED AS REQUIRED. CLEARANCE AS SHOWN MUST BE MAINTAINED BETWEEN CONDUITS.
- 3.) FOR FULL ENCASEMENT IN A TRENCH, A THREE-INCH MINIMUM CLEARANCE BETWEEN THE TRENCH BOTTOM AND THE LOWER TIER OF DUCTS SHALL BE MAINTAINED. TO MEET THIS REQUIREMENT, THE GRID-TYPE SPACER MUST BE SET UPON A BASE OF SUCH THICKNESS TO PROVIDE THREE INCHES OF CLEARANCE. THE SPACERS SHALL BE ANCHORED TO THE GROUND TO AVOID FLOATING DURING PLACEMENT OF SAND/CEMENT SLURRY.
- 4.) FOR TRENCH DETAILS FOR CONDUIT INSTALLATIONS, SEE STD PLAN MVEU-724A & MVEU-724B.

NOT TO SCALE



RECOMMENDED:  
*[Signature]* 12-27-2021  
 DIVISION MANAGER DATE  
 APPROVED:  
*[Signature]* 2/4/22  
 PUBLIC WORKS DIRECTOR / DATE  
 CITY ENGINEER

**CITY OF MORENO VALLEY**  
 FINANCIAL & MANAGEMENT SERVICES DEPARTMENT - ELECTRIC UTILITY DIVISION

**CONDUIT BANK REQUIREMENTS MVEU-727B-0**

STANDARD PLAN

SHEET 2 OF 2